


Not To Scale

Wing Walls Are @ 45°

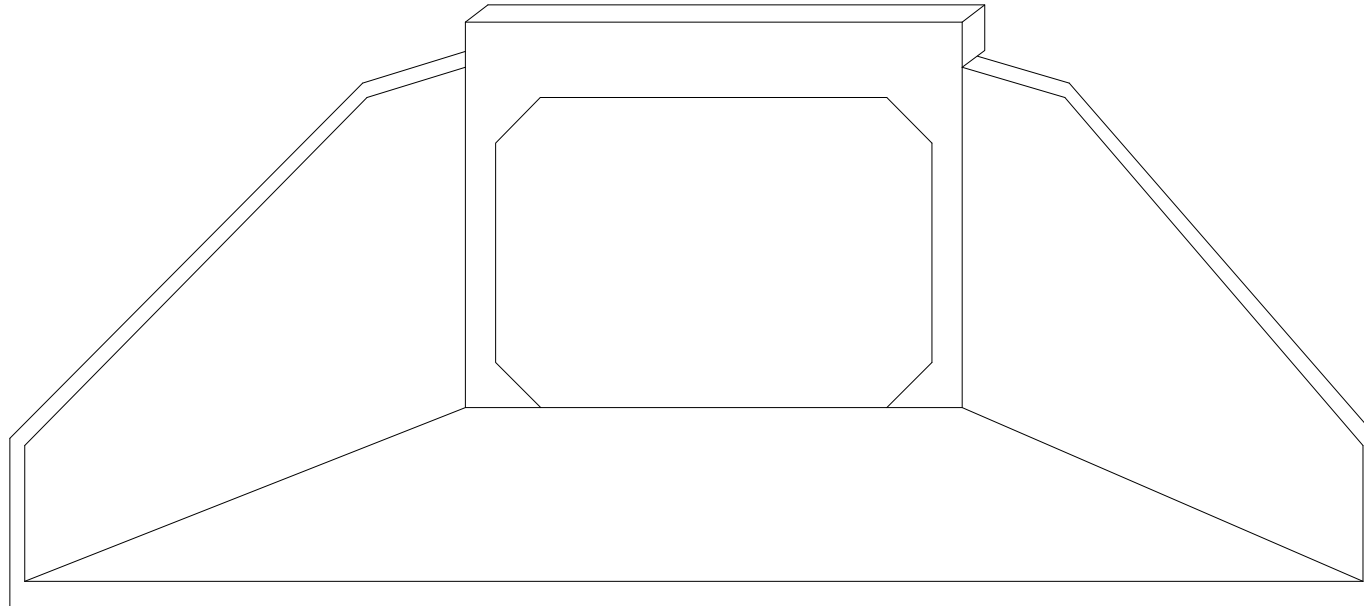

Dimensions Vary Per Design

General Notes

1. CONCRETE SHALL BE 4000 PSI MINIMUM
2. REINFORCING STEEL TO MEET ASTM-706
3. ALL PRECAST ELEMENTS SHALL MEET ASTM-C913
4. #4 REBAR@ 8" O.C. EACH WAY.
5. FOUR A-ANCHORS FOR LIFTING.
6. ALL WALLS ARE 8" THICK.



CATCH BASINS  
CONCRETE  
HEADWALLS  
CAST IRON GRATES &  
FRAMES

**MID-ATLANTIC DRAINAGE, INC**

MANHOLE CASTINGS  
PIPE  
STEEL PIPE  
GEOTEXTILE FABRICS  
EROSION CONTROL

1124 WHITE OAK LANE  
GALLIWAY TERR., 300  
(843) 356-4200

P. O. BOX 398  
NC 28643  
(842) 324-0888

**BOX CULVERT  
HEADWALL**

FILE NAME	SCB0014.DWG	Sheet
DATE	08.17.2009	1
DRAWN BY	JSW	